



AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D  
Pineville, NC 28134  
O: 704.405.2550  
F: 704.543.9772  
[www.americanflamecoat.com](http://www.americanflamecoat.com)

Client: ROYSONS CORPORATION  
40 VANDERHOOF AVENUE  
ROCKAWAY, NJ 07866

Test Report No: 65160-2

Date: 07.05.2018

The sample submitted by the client as: Roysons Corporation – TERRALON/X – Non-Vinyl  
Wallcovering  
(ADHERED)

DATE OF RECEIPT: 06.14.2018

TESTING PERIOD: 14 DAYS

TEST REQUESTED: The submitted sample was tested for flammability in  
Accordance with the procedures outlined in ASTM E-84-98.

SIGNED





## AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D  
Pineville, NC 28134  
O: 704.405.2550  
F: 704.543.9772  
[www.americanflamecoat.com](http://www.americanflamecoat.com)

Client: ROYSONS CORPORATION  
40 VANDERHOOF AVENUE  
ROCKAWAY, NJ 07866

Date: 07.05.2018

### **INTRODUCTION:**

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-98. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The tests were performed in accordance with the specifications set forth in ASTM E-84-98, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

### **PREPARATION AND CONDITIONING:**

The test sample identified as Roysons Corporation – TERRALON/X – Non-Vinyl Wallcovering was prepared by adhering the material to 5/8" Type X gypsum board glued using FR - Shur-Stik wallcovering adhesive. This method of sample preparation is described in ASTM E2404-15A, standard practice.

### **TEST PROCEDURE: Adhered**

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel and a test conducted in accordance with the standard ASTM E-84-98 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board of the day of the test.

This test sample **\*meets** the A.S.T.M. E-84 Standard

This test sample **\*meets** the N.F.P.A. LIFE SAFETY CODE 101.



## AMERICAN FLAMECOAT INC.

520 Eagleton Downs Drive - D  
Pineville, NC 28134  
O: 704.405.2550  
F: 704.543.9772  
www.americanflamecoat.com

Client: ROYSONS CORPORATION  
40 VANDERHOOF AVENUE  
ROCKAWAY, NJ 07866

Date: 07.05.2018

### **TEST RESULTS:**

The test results calculated in accordance with ASTM E-84-98 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: Roysons Corporation – TERRALON/X – Non-Vinyl Wallcovering  
(ADHERED)

Flame Index = 05

Smoke Developed Value = 90

**Observation:** Tested Fabric **Meets** the Requirements for ASTM E-84


### **Rating:** Class A

The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84)


The classifications are as follows:

Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450
Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450

Client: ROYSONS CORPORATION  
Report#: 65160-2  
Sample: Roysons Corporation – TERRALON/X – Non-Vinyl Wallcovering  
(ADHERED)

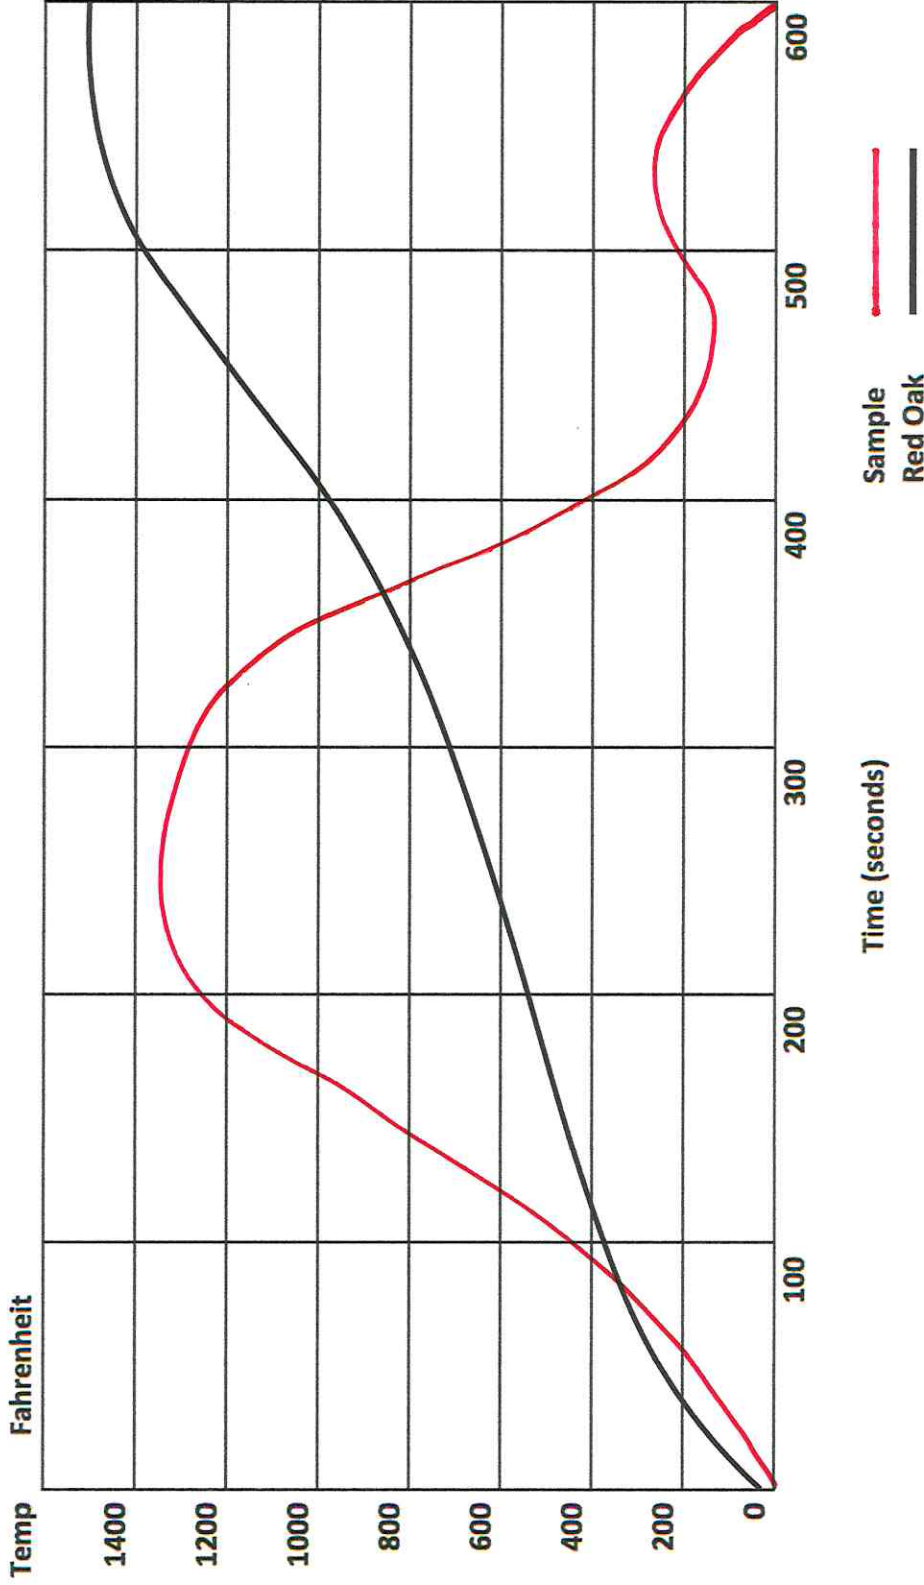

Client: ROYSONS CORPORATION  
Report#: 65160-2  
Sample: Roysons Corporation – TERRALON/X – Non-Vinyl Wallcovering  
(ADHERED)

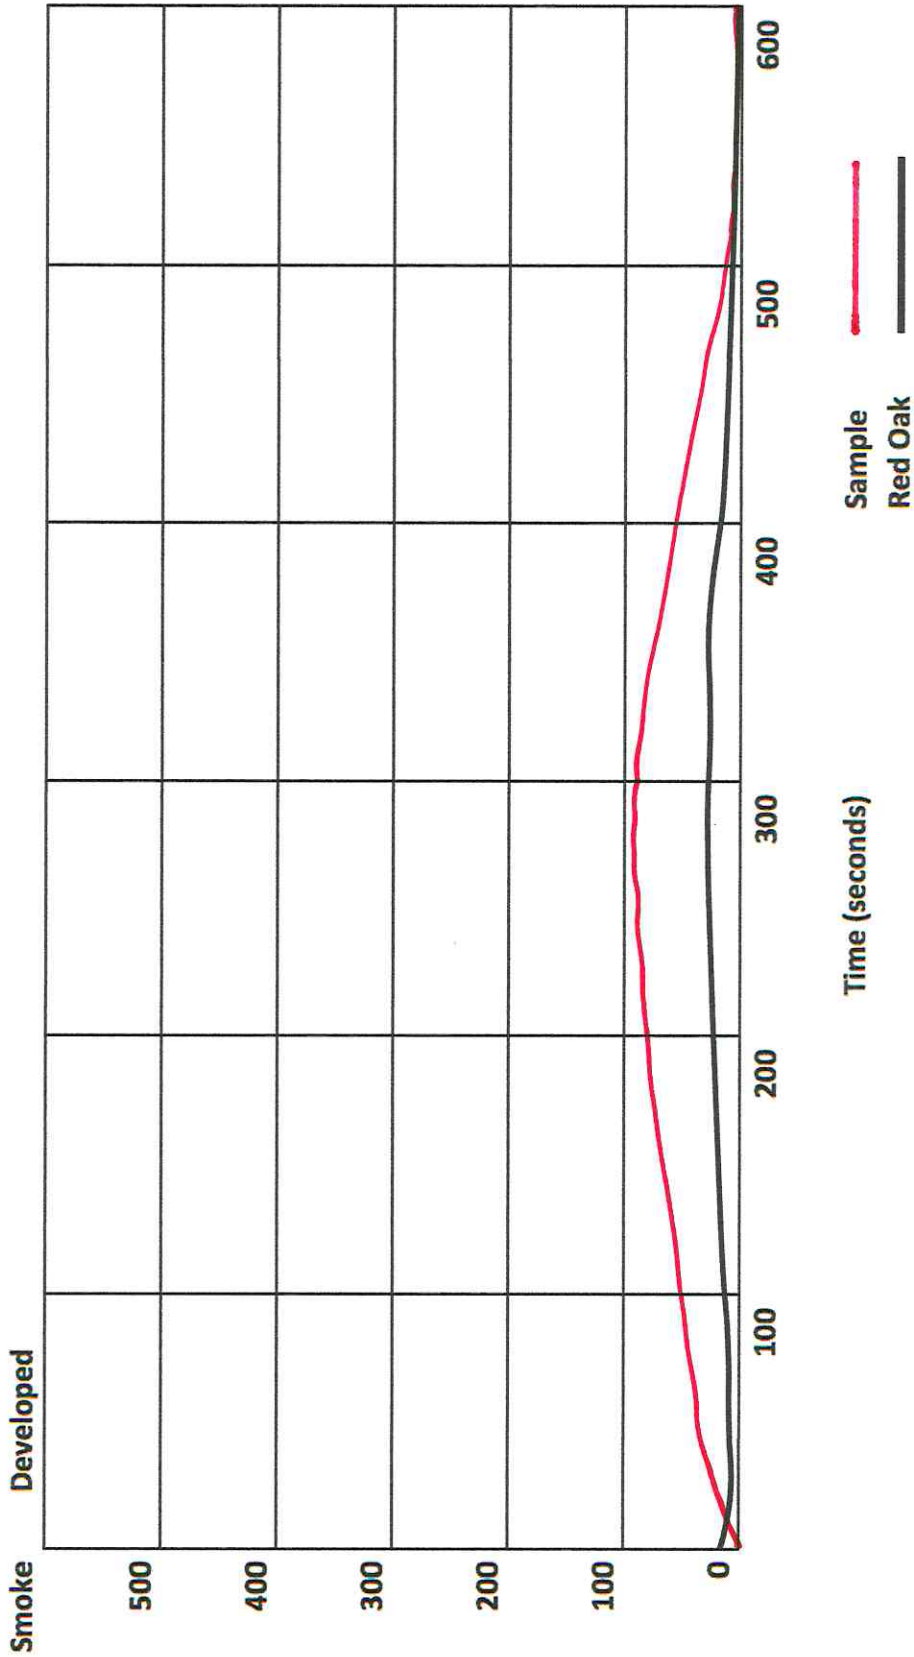



Client: ROYSONS CORPORATION  
Report#: 65160-2  
Sample: Roysons Corporation – TERRALON/X – Non-Vinyl Wallcovering  
(ADHERED)

